

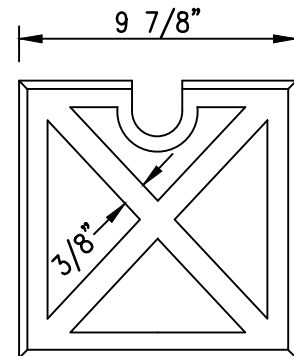


1. LETTER ON COVER SHALL BE "S" WHEN USED IN SAN. SEWER SYSTEM AND "W" WHEN USED IN WATER SYSTEM.
2. RISER FOR VALVE BOX SHALL MATCH TYPE OF PIPE USED FOR MAIN.

1. CAST IRON SHALL BE 35,000 PSI
2. ASTM A48 CLASS 35B

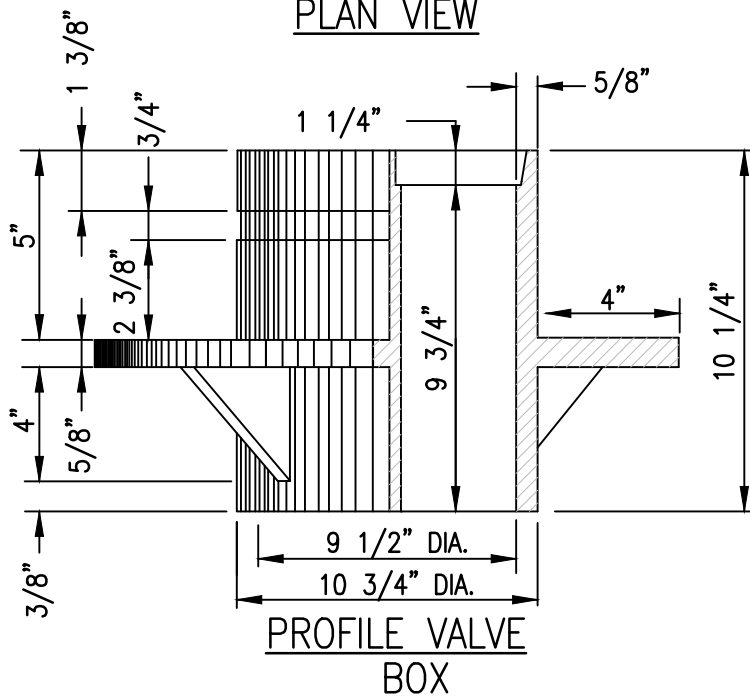

PLAN VIEW VALVE LID

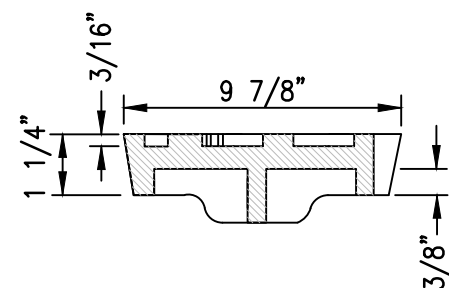

PROFILE VALVE
LID

CITY OF NORFOLK – DEPARTMENT OF UTILITIES
STANDARD DETAILS

**LARGE VALVE BOX
FOR MAINS 8 INCHES AND LARGER**

SCALE:
NOT TO SCALE

DRAWING NO.
CWS 01

DATE: 03/07